

Alarm test module

Alarm test module provides test and drain function for a wet fire sprinkler system, including the added components of pressure gauge and 3-way globe valve.

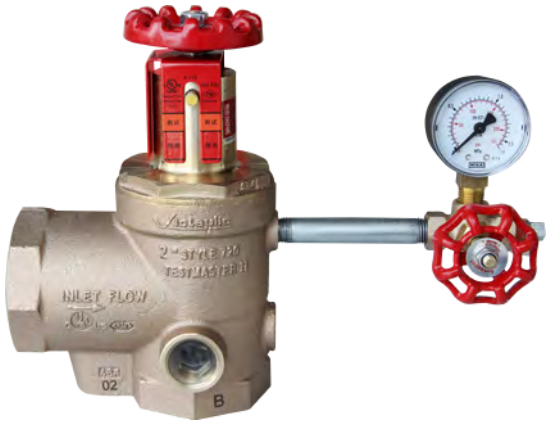

- Certificate: UL Listed / FM Approved
- Standard: UL 258, comply with NFPA 13
- Connection: Female thread, BSPT
- K-Factor: K5.6, K8.0 etc.
- W. pressure: 175 psi

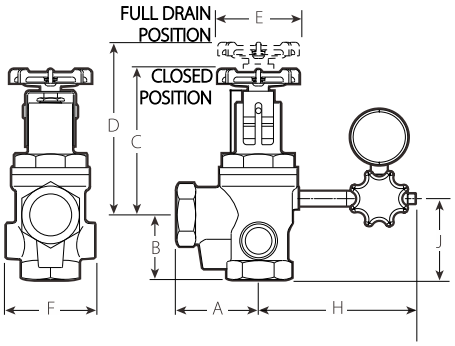

Main parts and material

Body	Bronze	**Handwheel**	Malleable iron
3-way globe valve	Bronze	**Pressure gauge**	1/4" NPT

Available size

Size		Dimension (mm)		Nominal K-Factor	Orifice	Connection	Working pressure (psi)	Ref. No.
NPS	DN	A	B					
1"	25	76	60	K5.6	1/2"	BSPT	175	VC0401 (UL/FM)
1"	25	76	60	K8.0	17/32"	BSPT	175	VC0402 (UL/FM)
1-1/4"	32	76	60	K5.6	1/2"	BSPT	175	VC0403 (UL/FM)
1-1/4"	32	76	60	K8.0	17/32"	BSPT	175	VC0404 (UL/FM)
1-1/2"	40	92	60	K5.6	1/2"	BSPT	175	VC0405 (UL/FM)
1-1/2"	40	92	60	K8.0	17/32"	BSPT	175	VC0406 (UL/FM)
2"	50	92	60	K5.6	1/2"	BSPT	175	VC0407 (UL/FM)
2"	50	92	60	K8.0	17/32"	BSPT	175	VC0408 (UL/FM)